

INSTALLATION MANUAL

SINGLE PACKAGE AIR CONDITIONER / ELECTRIC HEAT MODELS: PCE6 SERIES 2 THRU 5 TONS – 208/230V - 1 PHASE



LIST OF SECTIONS

GENERAL INFORMATION	1	OPERATION	14
SAFETY	1	MAINTENANCE	17
MODEL NUMBER NOMENCLATURE	2	TYPICAL WIRING DIAGRAMS	18
INSTALLATION	2	START UP SHEET	21
AIRFLOW PERFORMANCE	12		

LIST OF FIGURES

Component Location	3	Single-point Wiring Kits	10
Unit 4 Point Load Weight	4	Indoor Blower Control	16
Unit Dimensions	4	Measuring External Static Pressure	17
Bottom Duct Dimensions (inches)	5	Connection Wiring Diagram	18
Rear Duct Dimensions (inches)	5	Ladder Wiring Diagram	19
Typical Field Control Wiring Diagram For Air Conditioner Models ..	6	R-410A Quick Reference Guide	20
Typical Field Power Wiring Diagram	6		

LIST OF TABLES

Unit Limitations	3	Physical Data	11
Weights and Dimensions	4	Airflow Performance - Side Duct Application	12
Unit Dimensions	4	Electric Heat Multipliers	13
Unit Clearances	5	Additional Static Resistance	14
Electrical Data - 208/230-1-60 Single Source Power	7	Delay Profile Descriptions	15
Electrical Data for 208-1-60 Multi Source Power	8	Thermostat Signals	15
Electrical Data for 230-1-60 Multi Source Power	9	Recommended Blower Speed for Electric Heat	15
Single-point Wiring Kit Part Numbers	10	Enhanced ECM Indoor Blower Control Board Fault Codes	16
Electric Heat Blower Off Delay	10		

SECTION I: GENERAL INFORMATION

PCE units are factory assembled air conditioners designed for outdoor installation on a roof top or a slab. Field-installed electric heater accessories are available to provide electric heat.

The units are completely assembled on rigid, removable base rails. All piping, refrigerant charge, and electrical wiring is factory installed and tested. The units require only electric power and duct connections at the point of installation.

SECTION II: SAFETY



This is a safety alert symbol. When you see this symbol on labels or in manuals, be alert to the potential for personal injury.

Understand and pay particular attention to the signal words **DANGER**, **WARNING**, or **CAUTION**.

DANGER indicates an **imminently** hazardous situation, which, if not avoided, **will result in death or serious injury**.

WARNING indicates a **potentially** hazardous situation, which, if not avoided, **could result in death or serious injury**.

CAUTION indicates a potentially hazardous situation, which, if not avoided **may result in minor or moderate injury**. It is also used to alert against unsafe practices and hazards involving only property damage.

WARNING

*Improper installation may create a condition where the operation of the product could cause personal injury or property damage. Improper installation, adjustment, alteration, service or maintenance can cause injury or property damage. **Failure to carefully read and follow all instructions in this manual can result in furnace malfunction, death, personal injury and/or property damage.** Only a qualified contractor, installer or service agency should install this product.*

CAUTION

This product must be installed in strict compliance with the installation instructions and any applicable local, state, and national codes including, but not limited to building, electrical, and mechanical codes.

⚠ WARNING

Before performing service or maintenance operations on unit, turn off main power switch to unit. Electrical shock could cause personal injury. Improper installation, adjustment, alteration, service or maintenance can cause injury or property damage. Refer to this manual. For assistance or additional information consult a qualified installer, service agency or the gas supplier.

⚠ CAUTION

This system uses R-410A Refrigerant which operates at higher pressures than R-22. No other refrigerant may be used in this system. Gage sets, hoses, refrigerant containers and recovery systems must be designed to handle R-410A. If you are unsure, consult the equipment manufacturer. Failure to use R-410A compatible servicing equipment may result in property damage or injury.

Due to system pressure, moving parts, and electrical components, installation and servicing of air conditioning equipment can be hazardous. Only qualified, licensed service personnel should install, repair, or service this equipment. Unlicensed personnel can perform basic maintenance functions of cleaning coils and filters and replacing filters.

Observe all precautions in the literature, labels, and tags accompanying the equipment whenever working on air conditioning equipment. Be sure to follow all other applicable safety precautions and codes including.

Wear safety glasses and work gloves. Use quenching cloth and have a fire extinguisher available during brazing operations.

INSPECTION

As soon as a unit is received, it should be inspected for possible damage during transit. If damage is evident, the extent of the damage should be noted on the carrier's freight bill. A separate request for inspection by the carrier's agent should be made in writing.

REPLACEMENT PARTS

Contact your local Unitary Products parts distribution center for authorized replacement parts.

SECTION III: MODEL NUMBER NOMENCLATURE

PCE	4	A	24	50	2	X	1	A
1	2	3	4		6		8	9
1. Model Family PCE - packaged A/C with electric heat, PHE - packaged with electric heat, PCG - packaged A/C with gas heat, PHG - packaged with gas heat, 2. Nominal Cooling Efficiency 4 = 14 SEER, 6 = 16 SEER, etc. 3. Cabinet Size A = small 35 x 51, B = large 45 x 51 4. Nominal Air Conditioning Cooling Capacity BTUx1000 24 = 24,000 BTU, etc. Examples: PCE6B4221A is a packaged A/C with electric heat, 16 SEER, 3-1/2 ton, large cabinet, 230 volt, single phase, low-NOx model (first generation, first release).					5. Gas Heating Input BTU/Hr x 1000 050 = 50,000 BTU/Hr. input, blank = electric heat 6. Voltage-Phase-Frequency 2 = 208/230-1-60, 3=208/230-3-60, 4 = 460-3-60 7. NOx Approval X = low-NOx, blank = not low-NOx 8. Generation Level 1 = first generation 9. Revision Level A = original release, B = second release			

SECTION IV: INSTALLATION

LIMITATIONS


These units must be installed in accordance with the following national and local safety codes.

1. National Electrical Code ANSI/NFPA No. 70 or Canadian Electrical Code Part 1, C22.1 (latest editions).
2. Local plumbing and waste water codes and other applicable local codes.

Refer to Table 10 for unit physical data and to Tables 5-7 for electrical data.

If components are to be added to a unit to meet local codes, they are to be installed at the dealer's and/or the customer's expense.

Size of unit for proposed installation should be based on heat loss/heat gain calculations made in accordance with industry recognized procedures such as the Air Conditioning Contractors of America (Manual J).

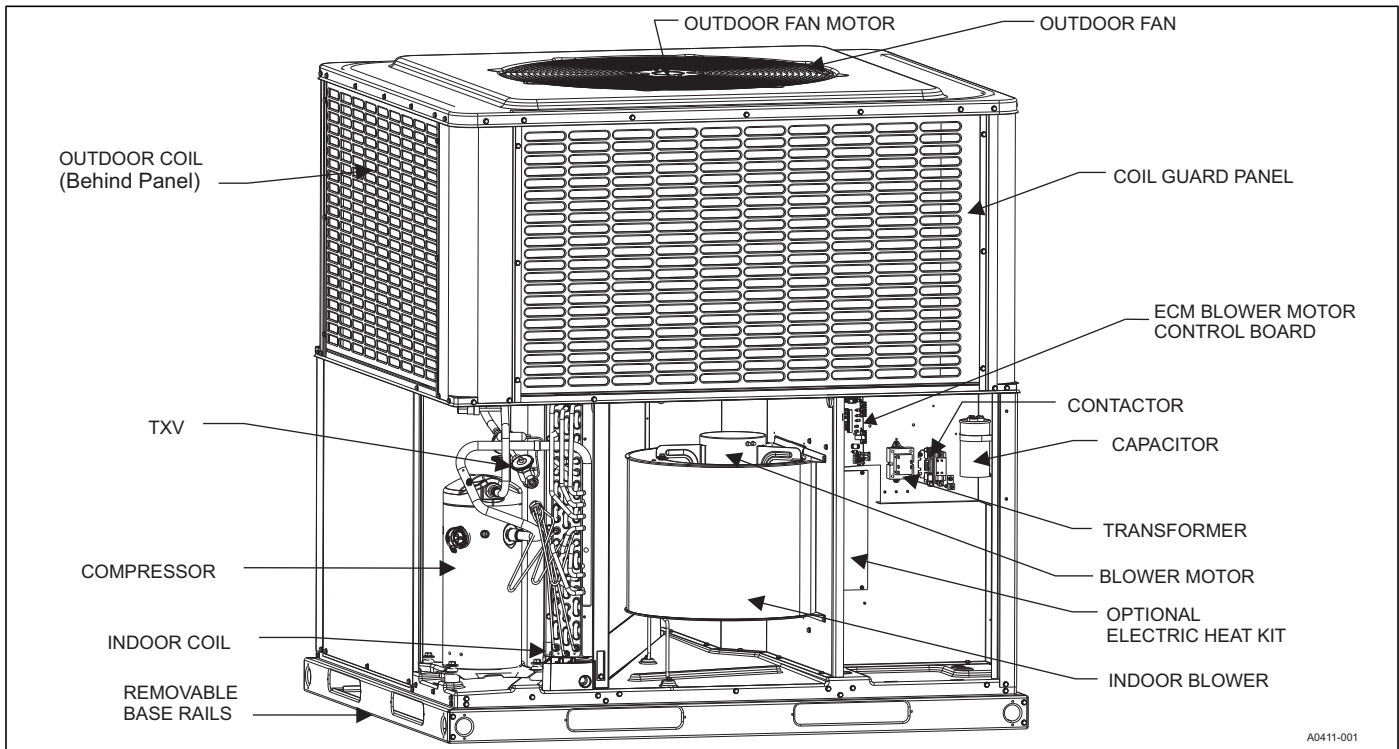

A0411-001

FIGURE 1: Component Location**Table 1:** Unit Limitations

Model	Unit Voltage	Unit Limitations		
		Applied Voltage		Outdoor DB Temp
		Min	Max	Max (°F)
All Models	208/230-1-60	187	252	125

LOCATION

Use the following guidelines to select a suitable location for these units:

- Unit is designed for **outdoor installation** only.
- Outdoor coils must have an unlimited supply of air. Where a choice of location is possible, position the unit on either north or east side of building.
- Suitable for mounting on roof curb.

⚠ WARNING

Do not attach supply and return duct work to the bottom of the unit base pan as the drain pan could be compromised.

- For ground level installation, a level pad or slab should be used. The thickness and size of the pad or slab used should meet local codes and unit weight. Do not tie the slab to the building foundation.
- Roof structures must be able to support the weight of the unit and its options/accessories. Unit must be installed on a solid, level roof curb or appropriate angle iron frame.
- Maintain level tolerance to 1/8" across the entire width and length of unit.

⚠ WARNING

Do not permit overhanging structures or shrubs to obstruct outdoor air discharge outlet.

CLEARANCES

All units require certain clearances for proper operation and service. Refer to Table 4 for the clearances required for construction, servicing and proper unit operation.

RIGGING AND HANDLING

Exercise care when moving the unit. Do not remove any packaging until the unit is near the place of installation. Rig the unit by attaching chain or cable slings to the lifting holes provided in the base rails. Spreader bars, whose length exceeds the largest dimension across the unit, **MUST** be used across the top of the unit.

⚠ CAUTION

Before lifting, make sure the unit weight is distributed equally on the rigging cables so it will lift evenly.

Units may be moved or lifted with a forklift. Slotted openings in the base rails are provided for this purpose.

⚠ CAUTION

If a unit is to be installed on a roof curb other than a Unitary Products roof curb, gasket or sealant must be applied to all surfaces that come in contact with the unit underside.

⚠ CAUTION

All panels must be secured in place when the unit is lifted.
The outdoor coils should be protected from rigging cable damage with plywood or other suitable material.

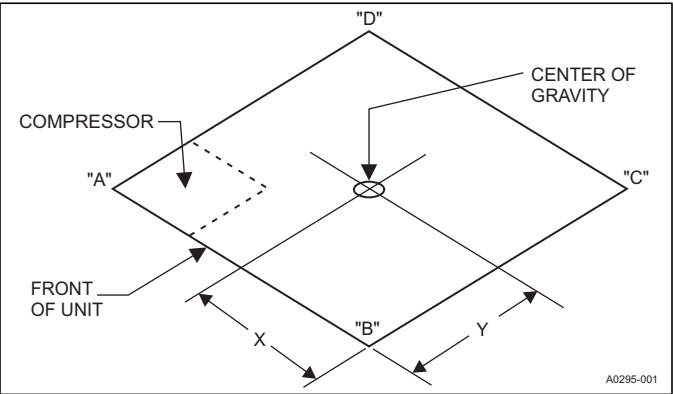


FIGURE 2: Unit 4 Point Load Weight

Table 2: Weights and Dimensions

Model	Weight (lbs.)		Center of Gravity		4 Point Load Location (lbs.)			
	Shipping	Operating	X	Y	A	B	C	D
PCE6A24	348	343	30	15	96	105	107	40
PCE6A30	394	389	30	15	107	123	123	41
PCE6B36	466	461	32	13	167	131	130	38
PCE6B42	471	466	32	13	169	132	131	39
PCE6B48	488	483	30	19	158	125	130	75
PCE6B60	505	500	30	20	157	134	140	74

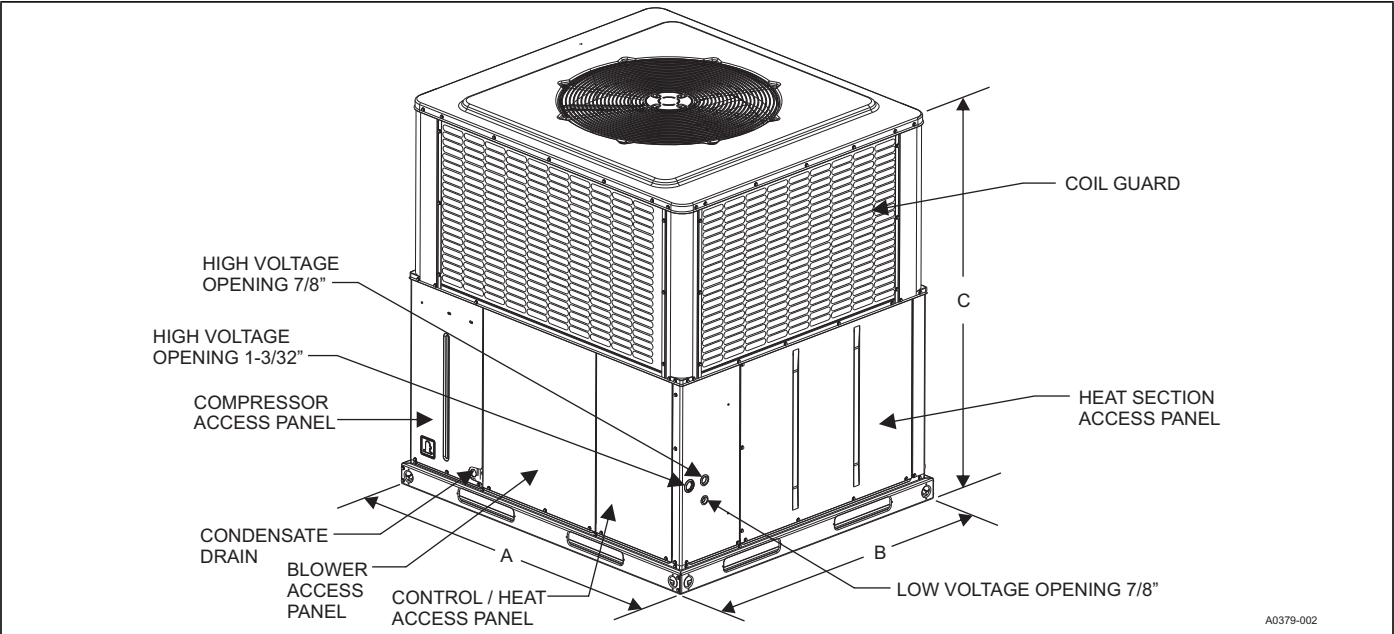


FIGURE 3: Unit Dimensions



Table 3: Unit Dimensions

Model	Dimensions		
	A	B	C
A24	51-1/4	35-3/4	47
A30	51-1/4	35-3/4	47
B36	51-1/4	45-3/4	49
B42	51-1/4	45-3/4	49
B48	51-1/4	45-3/4	53
B60	51-1/4	45-3/4	55

Table 4: Unit Clearances:

Direction	Distance (in.)	Direction	Distance (in.)
Top ¹	36	Right Side	36
Side Opposite Ducts	36	Left Side	24
Duct Panel	0	Bottom ^{2,3}	1

1. Minimum Clearance of 1 inch all sides of supply air duct for the first 3 feet of duct for 20 & 25 kW., zero inches thereafter. For all other heaters, zero inch clearance all sides for entire length of duct.
 2. Units must be installed outdoors. Overhanging structures or shrubs should not obscure outdoor air discharge outlet.
 3. Units may be installed on combustible floors made from wood or class A, B or C roof covering materials.
- NOTE: For units applied with a roof curb, the minimum clearance may be reduced from 1 inch to 1/2 inch between combustible roof curb material and this supply air duct.

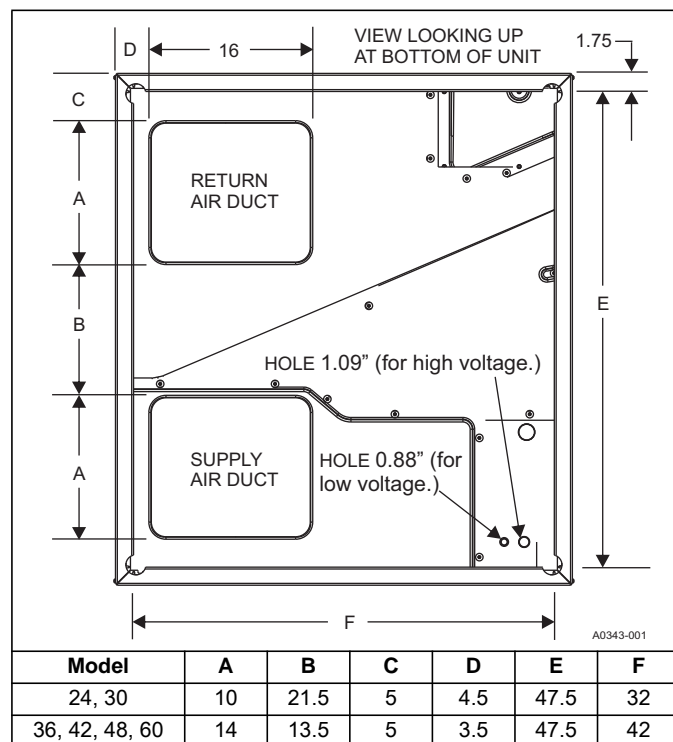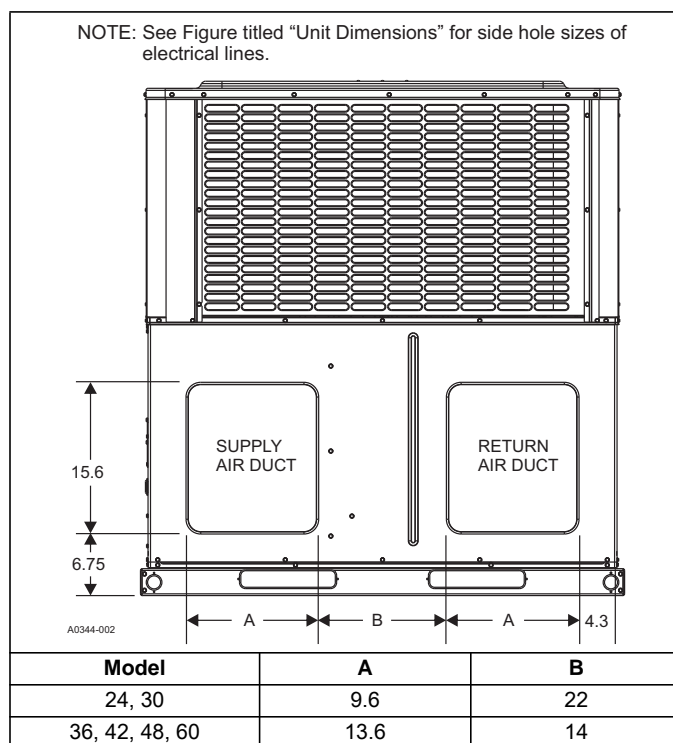**FIGURE 4:** Bottom Duct Dimensions (inches)**FIGURE 5:** Rear Duct Dimensions (inches)

DUCTWORK

NOTICE

All units are shipped in the horizontal supply/return configuration. It is important to reduce the possibility of any air leakage through the bottom duct covers (resulting from cut, torn, or rolled gasket) due to improper handling or shipping processes. To ensure a good tight seal, it is recommended that silicone caulk and/or foil tape be applied along the cover edges.

These units are adaptable to downflow use as well as rear supply and return air duct openings. To convert to downflow, use the following steps:

1. Remove the duct covers found in the bottom return and supply air duct openings. There are four (4) screws securing each duct cover (save these screws to use in Step 2).
2. Install the duct covers (removed in step one) to the rear supply and return air duct openings. Secure with the screws used in step one.
3. Seal duct covers with silicone caulk.

Duct work should be designed and sized according to the methods of the Air Conditioning Contractors of America (ACCA), as set forth in their Manual D.

A closed return duct system shall be used. This shall not preclude use of economizers or ventilation air intake. Flexible duct connectors are recommended in the supply and return duct work to minimize the transmission of vibration and noise.

CAUTION

When fastening duct work to the side duct flanges on the unit, insert the screws through the duct flanges only. DO NOT insert the screws through the casing. Outdoor duct work must be insulated and water-proofed.

NOTICE

Be sure to note supply and return openings.

Refer to Figures 4 and 5 for information concerning rear and bottom supply and return air duct openings.

FILTERS

Proper filter size is very important. Filter size, type and pressure drop should always be considered during duct system design.

Single phase units are shipped without a filter or filter racks. It is the responsibility of the installer to secure a filter in the return air ductwork or install a Filter/Frame Kit.

A filter rack and high velocity filters are standard on three phase units.

Filters must always be used and must be kept clean. When filters become dirt laden, insufficient air will be delivered by the blower, decreasing your units efficiency and increasing operating costs and wear-and-tear on the unit and controls.

Filters should be checked monthly; this is especially important since this unit is used for both heating and cooling.

CONDENSATE DRAIN

A condensate trap must be installed in the condensate drain. The plumbing must conform to local codes.

Use Teflon tape or pipe thread compound if needed.

CAUTION

Hand tighten only.

SERVICE ACCESS

Access to all serviceable components is provided at the following locations:

- Coil guards
- Unit top panel
- Corner posts
- Blower access panel
- Control access panel
- Indoor coil access panel
- Compressor access panel

Refer to Figure 3 for location of these access locations and minimum clearances in Table 4.

CAUTION

This system uses R-410A Refrigerant which operates at higher pressures than R-22. No other refrigerant may be used in this system. Gage sets, hoses, refrigerant containers and recovery systems must be designed to handle R-410A. If you are unsure, consult the equipment manufacturer. Failure to use R-410A compatible servicing equipment may result in property damage or injury.

WARNING

Wear safety glasses and gloves when handling refrigerants. Failure to follow this warning can cause serious personal injury.

Refer to Figure 13 for the R-410A Quick Reference Guide.

THERMOSTAT

The room thermostat should be located on an inside wall approximately 60" above the floor where it will not be subject to drafts, sun exposure or heat from electrical fixtures or appliances. Sealant should be used behind thermostat to prevent air infiltration. Follow manufacturer's instructions enclosed with the thermostat for general installation procedure. PCE6 model units all contain a multiple stage compressor, therefore a multi-stage thermostat must be used. Color coded insulated wires (minimum #18 AWG) should be used to connect thermostat to unit. See Figure 6.

If a field supplied electric heat kit is installed, this unit requires the use of a 1 heat / 2 cool (1H/2C) thermostat for proper operation. For units installed with 6HK heat kits of 13Kw and larger, a 2H/2C thermostat should be used. Do not use power stealing thermostats.

POWER AND CONTROL WIRING

Field wiring to the unit must conform to provisions of the current N.E.C. ANSI/NFPA No. 70 or C.E.C. and/or local ordinances. The unit must be electrically grounded in accordance with local codes or, in their absence, with the N.E.C./C.E.C. Voltage tolerances which must be

maintained at the compressor terminals during starting and running conditions are indicated on the unit Rating Plate and Table 1.

The wiring entering the cabinet must be provided with mechanical strain relief.

A fused disconnect switch should be field provided for the unit. If any of the wire supplied with the unit must be replaced, replacement wire must be of the type shown on the wiring diagram.

Electrical service must be sized properly to carry the load. Each unit must be wired with a separate branch circuit fed directly from the main distribution panel and properly fused.

Refer to Figures 6-8 for typical field wiring and to the appropriate unit wiring diagram for control circuit and wiring information.

Unit comes wired for 230 volt power. If supply power is 208 volt, wires connected to the control transformer 230V tap must be moved to the 208V tap.

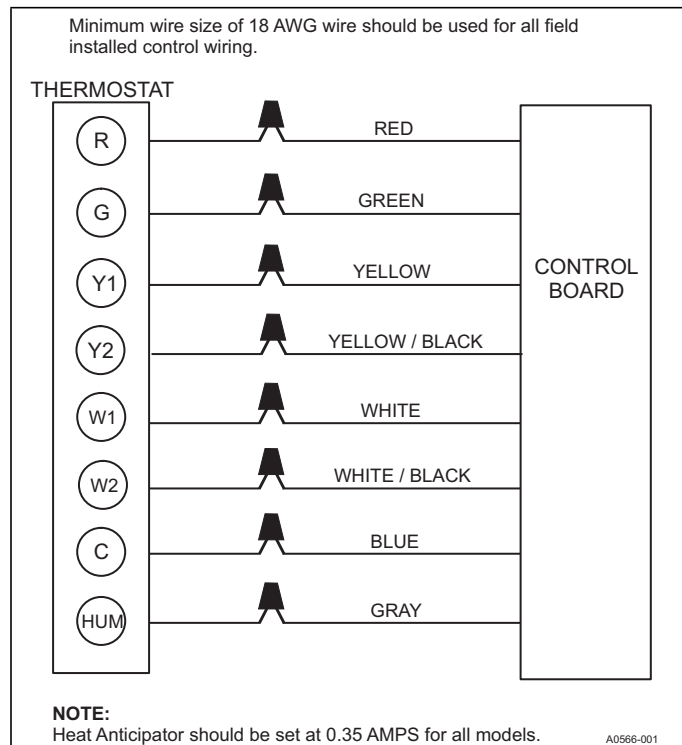


FIGURE 6: Typical Field Control Wiring Diagram For Air Conditioner Models

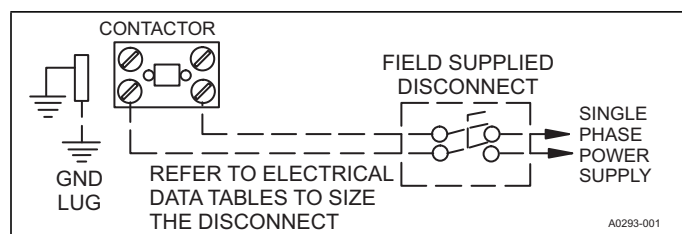


FIGURE 7: Typical Field Power Wiring Diagram

Table 5: Electrical Data - 208/230-1-60 Single Source Power

Model	Compressor			OD Fan Motor	Blower Motor	Electric Heat Option						MCA ¹ (Amps)		Max Fuse ² or Breaker ³ Size	
						Heater Kit ⁴	Heater kW		Stages	Heater Amps					
	RLA	LRA	MCC				FLA	FLA		208	230	208	230	208	230
A24	11.7	58.3	18.2	0.7	3.8	none	--	--	--	--	--	19.1	19.1	30	30
						6HK16500206	1.8	2.2	1	8.7	9.6	19.1	19.1	30	30
						6HK16500506	3.6	4.4	1	17.3	19.1	25.4	27.7	30	30
						6HK16500806	5.8	7.1	1	27.9	30.9	38.7	42.4	40	45
						6HK16501006	7.2	8.8	1	34.6	38.3	47.1	51.6	50	60
						6HK16501306	9.4	11.5	2	45.2	50.0	60.1	66.3	70	70
A30	14.6	73.0	20.4	0.8	3.8	none	--	--	--	--	--	22.9	22.9	35	35
						6HK16500206	1.8	2.2	1	8.7	9.6	22.9	22.9	35	35
						6HK16500506	3.6	4.4	1	17.3	19.1	25.4	27.7	35	35
						6HK16500806	5.8	7.1	1	27.9	30.9	38.7	42.4	40	45
						6HK16501006	7.2	8.8	1	34.6	38.3	47.1	51.6	50	60
						6HK16501306	9.4	11.5	2	45.2	50.0	60.3	66.3	70	70
B36	15.6	83.0	24.4	1.7	3.8	none	--	--	--	--	--	25.0	25.0	40	40
						6HK16500206	1.8	2.2	1	8.7	9.6	25.0	25.0	40	40
						6HK16500506	3.6	4.4	1	17.3	19.1	25.4	27.7	40	40
						6HK16500806	5.8	7.1	1	27.9	30.9	38.7	42.4	40	45
						6HK16501006	7.2	8.8	1	34.6	38.3	47.1	51.6	50	60
						6HK16501306	9.4	11.5	2	45.2	50.0	60.3	66.3	70	70
B42	17.9	96.0	28.0	1.7	5.4	none	--	--	--	--	--	29.5	29.5	45	45
						6HK16500506	3.6	4.4	1	17.3	19.1	29.5	29.5	45	45
						6HK16500806	5.8	7.1	1	27.9	30.9	40.3	44.0	45	45
						6HK16501006	7.2	8.8	1	34.6	38.3	48.7	53.2	50	60
						6HK16501306	9.4	11.5	2	45.2	50.0	61.9	67.9	70	70
						6HK16501506	10.8	13.2	2	51.9	57.4	70.3	77.1	80	80
B48	21.2	104.0	33.0	1.7	5.4	none	--	--	--	--	--	33.6	33.6	50	50
						6HK16500506	3.6	4.4	1	17.3	19.1	33.6	33.6	50	50
						6HK16500806	5.8	7.1	1	27.9	30.9	40.3	44.0	50	50
						6HK16501006	7.2	8.8	1	34.6	38.3	48.7	53.2	50	60
						6HK16501306	9.4	11.5	2	45.2	50.0	61.9	67.9	70	70
						6HK16501506	10.8	13.2	2	51.9	57.4	70.3	77.1	80	80
B60	26.9	152.9	42.0	1.7	7.0	none	--	--	--	--	--	42.3	42.3	60	60
						6HK16500506	3.6	4.4	1	17.3	19.1	42.3	42.3	60	60
						6HK16500806	5.8	7.1	1	27.9	30.9	42.3	45.6	60	60
						6HK16501006	7.2	8.8	1	34.6	38.3	50.3	54.8	60	60
						6HK16501306	9.4	11.5	2	45.2	50.0	63.5	69.5	70	70
						6HK16501506	10.8	13.2	2	51.9	57.4	71.9	78.7	80	80
B60	26.9	152.9	42.0	1.7	7.0	6HK16501806	13.0	15.9	2	62.5	69.1	85.1	93.4	90	100
						6HK16502006	14.4	17.6	2	69.2	76.5	93.5	102.7	100	110

1. Minimum Circuit Ampacity.
2. Maximum Over Current Protection per standard UL 1995.
3. Fuse or HACR circuit breaker is field installed.
4. Single Point Connection Kit required.

Table 6: Electrical Data for 208-1-60 Multi Source Power

Model	Compressor			OD Fan Motor	Blower Motor	Electric Heat Option				Multi Source							
	RLA	LRA	MCC	FLA	FLA	Heater Kit	Heater kW	Stages	Heater Amps	208	208 Max Fuse ² or Breaker ³ Size	208	208 Max Fuse ² or Breaker ³ Size	208	208 Max Fuse ² or Breaker ³ Size	208	208 Max Fuse ² or Breaker ³ Size
							208		208								
Multi Source: Compressor Circuit and Heat Circuits						Multi Source: Circuit #1 Compressor Circuit Circuit #2 - 1st Heater Circuit Circuit #3 - 2nd Heater Circuit Circuit #4 - 3rd Heater Circuit				MCA ¹ Amps	Fuse ² or Breaker ³ Size	MCA ¹ Amps	Fuse ² or Breaker ³ Size	MCA ¹ Amps	Fuse ² or Breaker ³ Size	MCA ¹ Amps	Fuse ² or Breaker ³ Size
										Circuit #1		Circuit #2		Circuit #3		Circuit #4	
A24	11.7	58.3	18.2	0.7	3.8	none	--	--	--	19.1	30	--	--	--	--	--	--
						6HK(0,1)6500206	1.8	1	8.7	19.1	30	10.8	15	--	--	--	--
						6HK(0,1)6500506	3.6	1	17.3	19.1	30	21.6	25	--	--	--	--
						6HK(0,1)6500806	5.8	1	27.9	16.0	30	34.9	40	--	--	--	--
						6HK(0,1)6501006	7.2	1	34.6	16.0	30	43.3	45	--	--	--	--
						6HK16501306	9.4	2	45.2	16.0	30	37.7	40	18.8	20	--	--
						6HK26501306	9.4	1	45.2	16.0	30	56.5	60	--	--	--	--
A30	14.6	73.0	20.4	0.8	3.8	none	--	--	--	22.9	35	--	--	--	--	--	--
						6HK(0,1)6500206	1.8	1	8.7	22.9	35	10.8	15	--	--	--	--
						6HK(0,1)6500506	3.6	1	17.3	22.9	35	21.6	25	--	--	--	--
						6HK(0,1)6500806	5.8	1	27.9	22.9	35	34.9	40	--	--	--	--
						6HK(0,1)6501006	7.2	1	34.6	22.9	35	43.3	45	--	--	--	--
						6HK16501306	9.4	2	45.2	22.9	35	37.7	40	18.8	20	--	--
						6HK16501506	10.8	2	51.9	22.9	35	43.3	50	21.6	25	--	--
B36	15.6	83.0	24.4	1.7	3.8	none	--	--	--	25.0	40	--	--	--	--	--	--
						6HK(0,1)6500206	1.8	1	8.7	25.0	40	10.8	15	--	--	--	--
						6HK(0,1)6500506	3.6	1	17.3	25.0	40	21.6	25	--	--	--	--
						6HK(0,1)6500806	5.8	1	27.9	25.0	40	34.9	40	--	--	--	--
						6HK(0,1)6501006	7.2	1	34.6	25.0	40	43.3	45	--	--	--	--
						6HK16501306	9.4	2	45.2	25.0	40	37.7	40	18.8	20	--	--
						6HK16501506	10.8	2	51.9	25.0	40	43.3	50	21.6	25	--	--
B42	17.9	96.0	28.0	1.7	5.4	none	--	1	--	29.5	45	--	--	--	--	--	--
						6HK(0,1)6500506	3.6	1	17.3	29.5	45	21.6	25	--	--	--	--
						6HK(0,1)6500806	5.8	1	27.9	29.5	45	34.9	40	--	--	--	--
						6HK(0,1)6501006	7.2	1	34.6	29.5	45	43.3	45	--	--	--	--
						6HK16501306	9.4	2	45.2	29.5	45	37.7	40	18.8	20	--	--
						6HK16501506	10.8	2	51.9	29.5	45	43.3	50	21.6	25	--	--
						6HK16501806	13.0	2	62.5	29.5	45	52.1	40	26.0	40	--	--
B48	21.2	104.0	33.0	1.7	5.4	none	--	--	--	33.6	50	--	--	--	--	--	--
						6HK(0,1)6500506	3.6	1	17.3	33.6	50	21.6	25	--	--	--	--
						6HK(0,1)6500806	5.8	1	27.9	33.6	50	34.9	40	--	--	--	--
						6HK(0,1)6501006	7.2	1	34.6	33.6	50	43.3	45	--	--	--	--
						6HK16501306	9.4	2	45.2	33.6	50	37.7	40	18.8	20	--	--
						6HK16501506	10.8	2	51.9	33.6	50	43.3	50	21.6	25	--	--
						6HK16501806	13.0	2	62.5	33.6	50	52.1	40	26.0	40	--	--
B60	26.9	152.9	42.0	1.7	7.0	none	--	--	--	42.3	60	--	--	--	--	--	--
						6HK(0,1)6500506	3.6	1	17.3	42.3	60	21.6	25	--	--	--	--
						6HK(0,1)6500806	5.8	1	27.9	42.3	60	34.9	40	--	--	--	--
						6HK(0,1)6501006	7.2	1	34.6	42.3	60	43.3	45	--	--	--	--
						6HK16501306	9.4	2	45.2	42.3	60	37.7	40	18.8	20	--	--
						6HK16501506	10.8	2	51.9	42.3	60	43.3	50	21.6	25	--	--
						6HK16501806	13.0	2	62.5	42.3	60	52.1	40	26.0	40	--	--
B60	26.9	152.9	42.0	1.7	7.0	none	--	--	--	42.3	60	--	--	--	--	--	--
						6HK(0,1)6500506	3.6	1	17.3	42.3	60	21.6	25	--	--	--	--
						6HK(0,1)6500806	5.8	1	27.9	42.3	60	34.9	40	--	--	--	--
						6HK(0,1)6501006	7.2	1	34.6	42.3	60	43.3	45	--	--	--	--
						6HK16501306	9.4	2	45.2	42.3	60	37.7	40	18.8	20	--	--
						6HK16501506	10.8	2	51.9	42.3	60	43.3	50	21.6	25	--	--
						6HK16501806	13.0	2	62.5	42.3	60	52.1	40	26.0	40	--	--
B60	26.9	152.9	42.0	1.7	7.0	none	--	--	--	42.3	60	--	--	--	--	--	--
						6HK(0,1)6500506	3.6	1	17.3	42.3	60	21.6	25	--	--	--	--
						6HK(0,1)6500806	5.8	1	27.9	42.3	60	34.9	40	--	--	--	--
						6HK(0,1)6501006	7.2	1	34.6	42.3	60	43.3	45	--	--	--	--
						6HK16501306	9.4	2	45.2	42.3	60	37.7	40	18.8	20	--	--
						6HK16501506	10.8	2	51.9	42.3	60	43.3	50	21.6	25	--	--
						6HK16501806	13.0	2	62.5	42.3	60	52.1	40	26.0	40	--	--
B60	26.9	152.9	42.0	1.7	7.0	none	--	--	--	42.3	60	--	--	--	--	--	--
						6HK(0,1)6500506	3.6	1	17.3	42.3	60	21.6	25	--	--	--	--
						6HK(0,1)6500806	5.8	1	27.9	42.3	60	34.9	40	--	--	--	--
						6HK(0,1)6501006	7.2	1	34.6	42.3	60	43.3	45	--	--	--	--
						6HK16501306	9.4	2	45.2	42.3	60	37.7	40	18.8	20	--	--
						6HK16501506	10.8	2	51.9	42.3	60	43.3	50	21.6	25	--	--
						6HK16501806	13.0	2	62.5	42.3	60	52.1	40	26.0	40	--	--
B60	26.9	152.9	42.0	1.7	7.0	none	--	--	--	42.3	60	--	--	--	--	--	--
						6HK(0,1)6500506	3.6	1	17.3	42.3	60	21.6	25	--	--	--	--
						6HK(0,1)6500806	5.8	1	27.9	42.3	60	34.9	40	--	--	--	--
						6HK(0,1)6501006	7.2	1	34.6	42.3	60	43.3	45	--	--	--	--
						6HK16501306	9.4	2	45.2	42.3	60	37.7	40	18.8	20	--	--
						6HK16501506	10.8	2	51.9	42.3	60	43.3	50	21.6	25	--	--
						6HK16501806	13.0	2	62.5	42.3	60	52.1	40	26.0	40	--	--
B60	26.9	152.9	42.0	1.7	7.0	none	--	--	--	42.3	60	--	--	--	--	--	--
						6HK(0,1)6500506	3.6	1	17.3	42.3	60	21.6	25	--	--	--	--
						6HK(0,1)6500806	5.8	1	27.9	42.3	60	34.9	40	--	--	--	--
						6HK(0,1)6501006	7.2	1	34.6	42.3	60	43.3	45	--	--	--	--
						6HK16501306	9.4	2	45.2	42.3	60	37.7	40	18.8	20	--	--
						6HK16501506	10.8	2	51.9	42.3	60	43.3	50	21.6	25	--	--
						6HK16501806	13.0	2	62.5	42.3	60	52.1	40	26.0	40	--	--
B60	26.9	152.9	42.0	1.7	7.0	none	--	--	--	42.3	60	--	--	--	--	--	--
						6HK(0,1)6500506	3.6	1	17.3	42.3	60	21.6	25	--	--	--	--
						6HK(0,1)6500806	5.8	1	27.9	42.3	60	34.9	40	--	--	--	--
						6HK(0,1)6501006	7.2	1	34.6	42.3	60	43.3	45	--	--	--	--
						6HK16501306	9.4	2	45.2	42.3	60	37.7	40	18.8	20	--	--
						6HK16501506	10.8	2	51.9	42.3	60	43.3	50	21.6	25	--	--
						6HK16501806	13.0	2	62.5	42.3	60	52.1	40	26.0	40	--	--
B60	26.9	152.9	42.0	1.7	7.0	none	--	--	--	42.3	60	--	--	--	--	--	--
						6HK(0,1)6500506	3.6	1	17.3	42.3	60	21.6	25	--	--	--	--
						6HK(0,1)6500806	5.8	1	27.9	42.3	60	34.9	40	--	--	--	--
						6HK(0,1)6501006	7.2	1	34.6	42.3	60	43.3	45	--	--	--	--
						6HK16501306	9.4	2	45.2	42.3	60	37.7	40	18.8	20	--	--
						6HK16501506	10.8	2	51.9	42.3	60	43.3	50	21.6	25	--	--
						6HK16501806	13.0	2	62.5	42.3	60	52.1	40	26.0	40	--	--
B60	26.9	152.9	42.0	1.7	7.0	none	--	--	--	42.3	60	--	--	--	--	--	--
						6HK(0,1)6500506	3.6	1	17.3	42.3	60	21.6	25	--	--	--	--
						6HK(0,1)6500806	5.8	1	27.9	42.3	60	34.9	40	--	--	--	--
						6HK(0,1)6501006	7.2	1	34.6	42.3	60	43.3	45	--	--	--	--
						6HK16501306	9.4	2	45.2	42.3	60	37.7	40	18.8	20	--	--
						6HK16501506	10.8	2	51.9	42.3	60	43.3	50	21.6	25	--	--
						6HK16501806	13.0	2	62.5	42.3	60	52.1	40	26.0	40	--	--
B60	26.9	152.9	42.0	1.7	7.0	none	--	--	--	42.3	60	--	--	--	--	--	--
						6HK(0,1)6500506	3.6	1	17.3	42.3	60	21.6	25	--	--	--	--
						6HK(0,1)6500806	5.8	1	27.9	42.3	60	34.9	40	--	--	--	--
						6HK(0,1)6501006	7.2	1	34.6	42.3	60	43.3	45	--	--	--	--
						6HK16501306	9.4	2	45.2	42.3	60	37.7	40	18.8	20	--	--
						6HK16501506	10.8	2	51.9	42.3	60	43.3	50	21.6	25	--	--
						6HK16501806	13.0	2	62.5	42.3	60	52.1	40	26.0	40	--	--
B60	26.9	152.9	42.0	1.7	7.0	none	--	--	--	42.3	60	--	--	--	--	--	--
						6HK(0,1)6500506	3.6	1	17.3	42.3	60	21.6	25	--	--	--	--
						6HK(0,1)6500806	5.8	1	27.9	42.3	60	34.9	40	--	--	--	--
						6HK(0,1)6501006	7.2	1	34.6	42.3	60	43.3	45	--	--	--	--
						6HK16501306	9.4	2	45.2	42.3	60	37.7	40	18.8	20	--	--
						6HK16501506	10.8	2	51.9	42.3	60	43.3	50	21.6	25	--	

Table 7: Electrical Data for 230-1-60 Multi Source Power

Model	Compressor			OD Fan Motor	Blower Motor	Electric Heat Option				Multi Source							
						Heater Kit	Heater kW	Stages	Heater Amps								
		230		230	230		230		230	230	230	230	230	230	230		
Multi Source: Compressor Circuit and Heat Circuits						Multi Source: Circuit #1 Compressor Circuit Circuit #2 - 1st Heater Circuit Circuit #3 - 2nd Heater Circuit Circuit #4 - 3rd Heater Circuit				MCA ¹ Amps	Max Fuse ² or Breaker ³ Size	MCA ¹ Amps	Max Fuse ² or Breaker ³ Size	MCA ¹ Amps	Max Fuse ² or Breaker ³ Size	MCA ¹ Amps	Max Fuse ² or Breaker ³ Size
										Circuit #1		Circuit #2		Circuit #3		Circuit #4	
A24	11.7	58.3	18.2	0.7	3.8	none	--	--	--	19.1	30	--	--	--	--	--	--
						6HK(0,1)6500206	2.2	1	9.6	19.1	30	12.0	15	--	--	--	--
						6HK(0,1)6500506	4.4	1	19.1	19.1	30	23.9	25	--	--	--	--
						6HK(0,1)6500806	7.1	1	30.9	16.0	30	38.6	40	--	--	--	--
						6HK(0,1)6501006	8.8	1	38.3	16.0	30	47.8	50	--	--	--	--
						6HK16501306	11.5	2	50.0	16.0	30	41.7	45	20.8	25	--	--
6HK26501306	11.5	1	50.0	16.0	30	62.5	70	--	--	--	--						
A30	14.6	73.0	20.4	0.8	3.8	none	--	--	--	22.9	35	--	--	--	--	--	--
						6HK(0,1)6500206	2.2	1	9.6	22.9	35	12.0	15	--	--	--	--
						6HK(0,1)6500506	4.4	1	19.1	22.9	35	23.9	25	--	--	--	--
						6HK(0,1)6500806	7.1	1	30.9	22.9	35	38.6	40	--	--	--	--
						6HK(0,1)6501006	8.8	1	38.3	22.9	35	47.8	50	--	--	--	--
						6HK16501306	11.5	2	50.0	22.9	35	41.7	45	20.8	25	--	--
						6HK16501506	13.2	2	57.4	22.9	35	47.8	50	23.9	25	--	--
						6HK26501306	11.5	1	50.0	22.9	35	62.5	70	--	--	--	--
6HK26501506	13.2	1	57.4	22.9	35	71.7	80	--	--	--	--						
B36	15.6	83.0	24.4	1.7	3.8	none	--	--	--	25.0	40	--	--	--	--	--	--
						6HK(0,1)6500206	2.2	1	9.6	25.0	40	12.0	15	--	--	--	--
						6HK(0,1)6500506	4.4	1	19.1	25.0	40	23.9	25	--	--	--	--
						6HK(0,1)6500806	7.1	1	30.9	25.0	40	38.6	40	--	--	--	--
						6HK(0,1)6501006	8.8	1	38.3	25.0	40	47.8	50	--	--	--	--
						6HK16501306	11.5	2	50.0	25.0	40	41.7	45	20.8	25	--	--
						6HK16501506	13.2	2	57.4	25.0	40	47.8	50	23.9	25	--	--
						6HK26501306	11.5	1	50.0	25.0	40	62.5	70	--	--	--	--
6HK26501506	13.2	2	57.4	25.0	40	71.7	80	--	--	--	--						
B42	17.9	96.0	28.0	1.7	5.4	none	--	1	--	29.5	45	--	--	--	--	--	--
						6HK(0,1)6500506	4.4	1	19.1	29.5	45	23.9	25	--	--	--	--
						6HK(0,1)6500806	7.1	1	30.9	29.5	45	38.6	40	--	--	--	--
						6HK(0,1)6501006	8.8	1	38.3	29.5	45	47.8	50	--	--	--	--
						6HK16501306	11.5	2	50.0	29.5	45	41.7	45	20.8	25	--	--
						6HK16501506	13.2	2	57.4	29.5	45	47.8	50	23.9	25	--	--
						6HK16501806	15.9	2	69.1	29.5	45	57.6	45	28.8	45	--	--
						6HK16502006	17.6	2	76.5	29.5	45	47.8	50	47.8	50	--	--
						6HK26501306	11.5	1	50.0	29.5	45	62.5	70	--	--	--	--
						6HK26501506	13.2	1	57.4	29.5	45	71.7	80	--	--	--	--
6HK26501806	15.9	1	69.1	29.5	45	86.4	90	--	--	--	--						
6HK26502006	17.6	1	76.5	29.5	45	95.7	100	--	--	--	--						
B48	21.2	104.0	33.0	1.7	5.4	none	--	--	--	33.6	50	--	--	--	--	--	--
						6HK(0,1)6500506	4.4	1	19.1	33.6	50	23.9	25	--	--	--	--
						6HK(0,1)6500806	7.1	1	30.9	33.6	50	38.6	40	--	--	--	--
						6HK(0,1)6501006	8.8	1	38.3	33.6	50	47.8	50	--	--	--	--
						6HK16501306	11.5	2	50.0	33.6	50	41.7	45	20.8	25	--	--
						6HK16501506	13.2	2	57.4	33.6	50	47.8	50	23.9	25	--	--
						6HK16501806	15.9	2	69.1	33.6	50	57.6	45	28.8	45	--	--
						6HK16502006	17.6	2	76.5	33.6	50	47.8	50	47.8	50	--	--
						6HK26501306	11.5	1	50.0	33.6	50	62.5	70	--	--	--	--
						6HK26501506	13.2	1	57.4	33.6	50	71.7	80	--	--	--	--
6HK26501806	15.9	1	69.1	33.6	50	86.4	90	--	--	--	--						
6HK26502006	17.6	2	76.5	33.6	50	95.7	100	--	--	--	--						
B60	26.9	152.9	42.0	1.7	7.0	none	--	--	--	42.3	60	--	--	--	--	--	--
						6HK(0,1)6500506	4.4	1	19.1	42.3	60	23.9	25	--	--	--	--
						6HK(0,1)6500806	7.1	1	30.9	42.3	60	38.6	40	--	--	--	--
						6HK(0,1)6501006	8.8	1	38.3	42.3	60	47.8	50	--	--	--	--
						6HK16501306	11.5	2	50.0	42.3	60	41.7	45	20.8	25	--	--
						6HK16501506	13.2	2	57.4	42.3	60	47.8	50	23.9	25	--	--
						6HK16501806	15.9	2	69.1	42.3	60	57.6	45	28.8	45	--	--
						6HK16502006	17.6	2	76.5	42.3	60	47.8	50	47.8	50	--	--
						6HK26501306	11.5	1	50.0	42.3	60	62.5	70	--	--	--	--
						6HK26501506	13.2	1	57.4	42.3	60	71.7	80	--	--	--	--
						6HK26501806	15.9	1	69.1	42.3	60	86.4	90	--	--	--	--
						6HK26502006	17.6	1	76.5	42.3	60	95.7	100	--	--	--	--
						6HK16502506	22.0	3	95.7	42.3	60	47.8	50	47.8	50	23.9	25
						6HK26502506	22.0	1	95.7	42.3	60	119.6	125	--	--	--	--

1. MCA = Minimum Circuit Ampacity.
2. Maximum Over Current Protection per standard UL 1995.
3. Fuse or HACR circuit breaker is field installed.

SINGLE-POINT WIRING KITS

NOTE:

For single circuit heater kits, remove the wires for the second circuit from the single-point block.

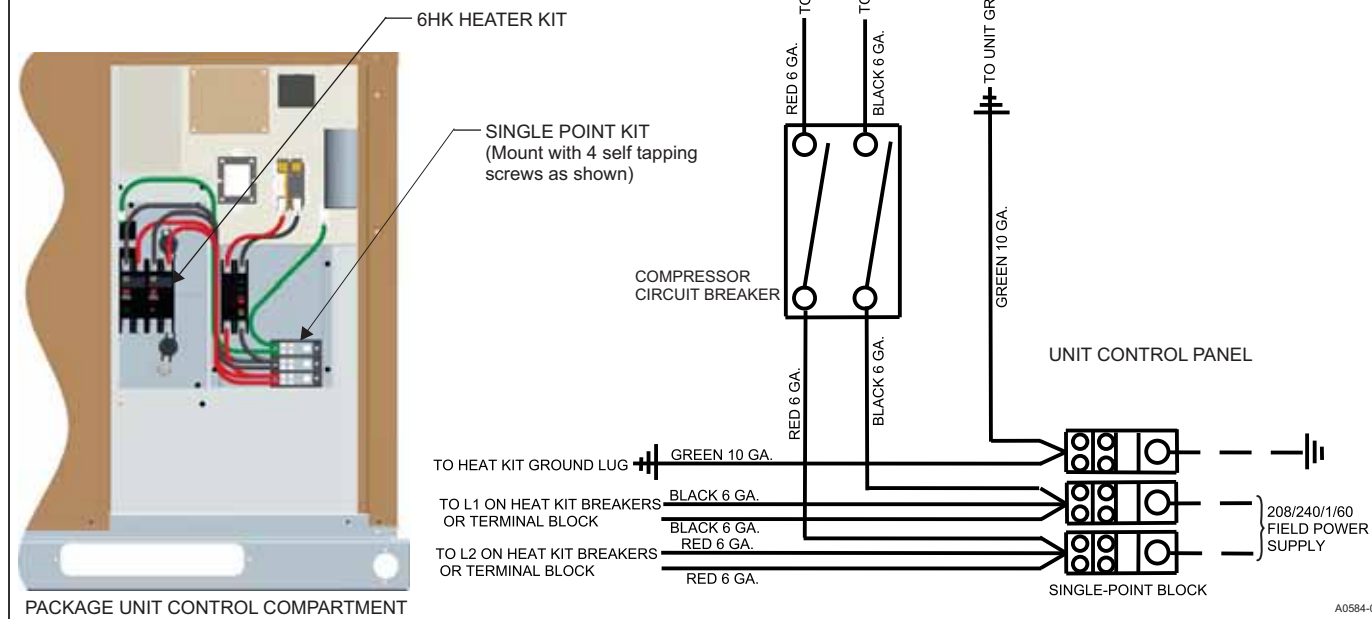


FIGURE 8: Single-point Wiring Kits

Table 8: Single-point Wiring Kit Part Numbers

Single Point Kit P/N	Unit Model Number	Compressor Breaker Size	Heat Kit
S1-2SPWK001	PCE6A24	30 Amp	up to 13 kW
S1-2SPWK002	PCE6A30	35 Amp	up to 15 kW
S1-2SPWK007	PCE6B36	40 Amp	up to 15 kW
S1-2SPWK003	PCE6B42	45 Amp	up to 20 kW
S1-2SPWK004	PCE6B48	50 Amp	up to 20 kW
S1-2SPWK005	PCE6B60	60 Amp	up to 20 kW

Table 9: Electric Heat Blower Off Delay

Model ID	Blower Off Delay In Seconds
PCE6A24	0
PCE6A30	60
PCE6B36	60
PCE6B42	110
PCE6B48	110
PCE6B60	110

Table 10: Physical Data

NOMINAL TONNAGE	MODELS					
	PCE6A24	PCE6A30	PCE6B36	PCE6B42	PCE6B48	PCE6B60
	2.0	2.5	3.0	3.5	4.0	5.0
AHRI Cooling Performance						
Gross Capacity @ AHRI A point (MBH)	24.6	30.7	36.5	43.3	49.1	60.0
AHRI net capacity (MBH)	24.0	30.0	36.0	42.5	45.5	58.0
EER	12.5	12.5	12.5	12.5	12.0	12.0
SEER	16.0	16.0	16.0	16.0	16.0	16.0
Nominal CFM	800	1000	1200	1400	1600	2000
System power (KW)	2.0	2.4	3.0	3.4	3.6	4.6
Refrigerant type	R410A	R410A	R410A	R410A	R410A	R410A
Refrigerant charge (lb-oz)	6-8	8-2	11-8	11-4	13-8	14-0
Dimensions (inches)						
Length	51-1/4	51-1/4	51-1/4	51-1/4	51-1/4	51-1/4
Width	35-3/4	35-3/4	45-3/4	45-3/4	45-3/4	45-3/4
Height	47	47	49	49	53	55
Operating WT. (lbs.)	343	389	460	466	483	500
Compressors						
Type	Scroll	Scroll	Scroll	Scroll	Scroll	Scroll
Stages	2	2	2	2	2	2
Outdoor Coil Data						
Face area (Sq. Ft.)	15.1	15.1	19.5	19.5	23.8	25.9
Rows	1	2	2	2	2	2
Fins per inch	22	22	22	22	22	22
Tube diameter	3/8	3/8	3/8	3/8	3/8	3/8
Circuitry Type	Interlaced	Interlaced	Interlaced	Interlaced	Interlaced	Interlaced
Indoor Coil Data						
Face area (Sq. Ft.)	4.6	4.6	6.3	6.3	6.3	6.3
Rows	3	3	3	3	3	4
Fins per inch	16	16	16	16	16	16
Tube diameter	3/8	3/8	3/8	3/8	3/8	3/8
Circuitry Type	Interlaced	Interlaced	Interlaced	Interlaced	Interlaced	Interlaced
Refrigerant control	TXV	TXV	TXV	TXV	TXV	TXV
Outdoor Fan Data						
Fan diameter (Inch)	24	24	26	26	26	26
Type	Prop	Prop	Prop	Prop	Prop	Prop
Drive type	Direct	Direct	Direct	Direct	Direct	Direct
No. speeds	1	1	1	1	1	1
Motor HP each	1/10	1/8	1/3	1/3	1/3	1/3
RPM	850	850	850	850	850	850
Nominal total CFM	2400	2400	3200	3200	3200	3200
Direct Drive Indoor Fan Data						
Fan Size (Inch)	11 x 8	11 x 8	11 x 10	11 x 10	11 x 10	11 x 10
Type	Centrifugal	Centrifugal	Centrifugal	Centrifugal	Centrifugal	Centrifugal
Motor HP each	1/2	1/2	1/2	3/4	3/4	1
RPM	1200 Max	1200 Max	1200 Max	1200 Max	1200 Max	1200 Max
Frame size	48	48	48	48	48	48
Filters						
Filter Size	A	A	B	B	B	B
Quantity size	Field-supplied external filters must be sized so as not to exceed 300 fpm air velocity through disposable filters. For internal filter use, a filter rack kit is available. Consult the instructions supplied with that kit for replacement filter sizes. Filter sizes: A=20x20, B=20x30.					

COMPRESSORS

The compressor used in this product is specifically designed to operate with R-410A Refrigerant and cannot be interchanged. Compressors used in PCE6 models contain two internal bypass ports which enable the compressor to operate at 67% part load capacity.

⚠ CAUTION

This system uses R-410A Refrigerant which operates at higher pressures than R-22. No other refrigerant may be used in this system.

The compressor uses polyolester (POE oil), Mobile 3MA POE. This oil is extremely hygroscopic, meaning it absorbs water readily. POE oil can absorb 15 times as much water as other oils designed for HCFC and CFC refrigerants. If refrigerant circuit is opened, take all necessary precautions to avoid exposure of the oil to the atmosphere.

⚠ CAUTION

*Do not leave the system open to the atmosphere. Unit damage could occur due to moisture being absorbed by the **POE oil** in the system. This type of oil is highly susceptible to moisture absorption*

POE (polyolester) compressor lubricants are known to cause long term damage to some synthetic roofing materials.

⚠ CAUTION

Exposure, even if immediately cleaned up, may cause embrittlement (leading to cracking) to occur in one year or more. When performing any service that may risk exposure of compressor oil to the roof, take precautions to protect roofing.

Procedures which risk oil leakage include, but are not limited to, compressor replacement, repairing refrigerant leaks, replacing refrigerant components such as filter drier, pressure switch, metering device or coil.

⚠ CAUTION

Do not loosen compressor mounting bolts.

Units are shipped with compressor mountings which are factory-adjusted and ready for operation.

SECTION V: AIRFLOW PERFORMANCE

Table 11: Airflow Performance - Side Duct Application

Model	Jumper Position		External Static Pressure (Inches WC)									
			0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9	1.0
			SCFM	SCFM	SCFM	SCFM	SCFM	SCFM	SCFM	SCFM	SCFM	SCFM
24	High Cool	A	961	923	874	822	776	735	682	624	581	552
		B	910	837	780	729	685	631	576	529	495	453
		C	870	761	699	649	605	539	484	449	422	370
		D	799	623	552	475	436	387	338	294	237	192
	Low Cool	A	902	822	764	713	669	612	557	513	480	437
		B	855	734	669	615	572	509	454	418	385	334
		C	827	678	611	545	504	448	396	356	311	263
		D	675	546	466	404	347	277	205	160	126	80
	Electric Heat	A	1033	1002	963	917	862	826	781	735	678	655
		B	961	923	874	822	776	735	682	624	581	552
		C	910	837	780	729	685	631	576	529	495	453
		D	878	777	715	665	621	558	502	465	437	386
30	High Cool	A	1141	1116	1079	1038	991	946	905	864	820	776
		B	1054	1024	988	944	886	852	809	766	706	684
		C	1023	991	950	903	850	813	767	719	664	640
		D	910	837	780	729	685	631	576	529	495	453
	Low Cool	A	982	946	899	849	801	761	710	656	609	581
		B	927	867	813	761	717	667	612	561	524	487
		C	870	761	699	649	605	539	484	449	422	370
		D	813	650	582	510	470	417	367	325	274	227
	Electric Heat	A	1108	1082	1045	1003	952	911	869	827	777	742
		B	1002	968	925	876	825	787	738	687	636	611
		C	886	792	731	681	637	576	520	481	451	403
		D	827	678	611	545	504	448	396	356	311	263
36	High Cool	A	1345	1318	1271	1222	1172	1108	1035	961	894	841
		B	1264	1211	1170	1115	1056	981	894	826	775	729
		C	1232	1178	1131	1077	1012	929	853	790	738	690
		D	1058	999	931	859	762	694	635	582	523	459
	Low Cool	A	1153	1095	1036	979	899	810	751	697	643	588
		B	1015	952	884	802	709	646	582	528	467	402
		C	882	805	741	625	556	501	415	359	297	228
		D	805	718	642	523	436	376	294	247	193	118
	Electric Heat	A	1190	1133	1079	1026	953	861	798	742	689	638
		B	1112	1054	991	928	840	760	701	648	591	532
		C	955	886	821	721	642	584	508	453	391	324
		D	856	776	708	591	516	459	375	321	262	191

Reference Table 11 NOTES at end of Table on next page.

Table 11: Airflow Performance - Side Duct Application (Continued)

Model	Jumper Position		External Static Pressure (Inches WC)									
			0.1 SCFM	0.2 SCFM	0.3 SCFM	0.4 SCFM	0.5 SCFM	0.6 SCFM	0.7 SCFM	0.8 SCFM	0.9 SCFM	1.0 SCFM
42	High Cool	A	1555	1518	1494	1459	1414	1360	1318	1261	1220	1162
		B	1473	1435	1406	1368	1320	1264	1220	1164	1119	1060
		C	1374	1333	1298	1255	1204	1145	1100	1044	993	933
		D	1216	1168	1117	1064	1007	942	892	838	775	712
	Low Cool	A	1233	1186	1137	1085	1029	965	915	861	799	736
		B	1139	1087	1027	968	907	839	785	733	663	598
		C	1025	966	892	823	756	684	625	575	494	427
		D	964	900	816	742	672	596	534	485	398	329
	Electric Heat	A	1441	1407	1373	1325	1279	1232	1182	1108	1042	1039
		B	1327	1286	1242	1192	1143	1081	1024	949	881	834
		C	1187	1136	1084	1028	968	886	827	767	702	657
		D	1087	1031	974	909	832	750	704	653	600	537
48	High Cool	A	1851	1809	1781	1746	1707	1656	1609	1552	1518	1460
		B	1689	1652	1630	1597	1556	1504	1461	1404	1368	1310
		C	1614	1578	1554	1520	1477	1424	1382	1324	1286	1228
		D	1374	1333	1298	1255	1204	1145	1100	1044	993	933
	Low Cool	A	1473	1435	1406	1368	1320	1264	1220	1164	1119	1060
		B	1374	1333	1298	1255	1204	1145	1100	1044	993	933
		C	1322	1278	1238	1191	1138	1077	1030	975	920	859
		D	1286	1241	1197	1149	1095	1032	984	930	872	810
	Electric Heat	Elec- tric Heat	1441	1407	1373	1325	1279	1232	1182	1108	1042	1039
			1327	1286	1242	1192	1143	1081	1024	949	881	834
			1187	1136	1084	1028	968	886	827	767	702	657
			1087	1031	974	909	832	750	704	653	600	537
60	High Cool	A	2149	2114	2077	2030	1989	1948	1905	1859	1816	1768
		B	2013	1977	1941	1898	1860	1816	1772	1726	1677	1630
		C	1936	1900	1864	1822	1783	1739	1695	1649	1597	1551
		D	1719	1685	1642	1600	1555	1508	1465	1418	1372	1327
	Low Cool	A	1629	1591	1546	1502	1455	1409	1362	1315	1266	1220
		B	1558	1516	1469	1423	1375	1329	1280	1232	1181	1135
		C	1453	1406	1355	1305	1255	1207	1153	1100	1047	997
		D	1410	1361	1307	1255	1204	1155	1100	1044	992	938
	Electric Heat	A	1743	1712	1666	1623	1580	1540	1493	1449	1404	1370
		B	1485	1436	1380	1329	1283	1234	1185	1139	1084	1032
		C	1382	1324	1265	1210	1162	1108	1059	1012	952	891
		D	1205	1131	1066	1005	953	892	841	793	724	644

NOTES:

1. Airflow tested with dry coil conditions, without air filters, at 230 volts.
2. Applications above 0.8" w.c. external static pressure are not recommended.
3. Brushless DC high efficiency enhanced ECM blower motor used for all indoor blower assemblies.
4. Minimal variations in airflow performance data results from operating at 208 volts. Data above may be used in those cases.
5. Minimal variations in airflow performance data results from using downflow duct applications. Data above may be used in those cases.
6. Heating applications tested at 0.50" w.c. esp, and cooling applications tested at 0.30" w.c. esp per standards.

Table 12: Electric Heat Multipliers

Voltage		kW Capacity Multipliers ¹
Nominal	Applied	
240	208	0.75
	230	0.92

1. Electric heaters are rated at nominal voltage. Use this table to determine the electric heat capacity for heaters applied at lower voltages.

Table 13: Additional Static Resistance

Size (Tons)	CFM	Wet Indoor Coil	Economizer ¹	Filter/Frame Kit
24 (2.0)	500	0.01	0.00	0.01
	600	0.01	0.00	0.02
	700	0.01	0.00	0.04
	800	0.02	0.01	0.06
	900	0.03	0.01	0.08
	1000	0.04	0.01	0.10
	1100	0.05	0.01	0.13
	1200	0.06	0.02	0.16
30 (2.5)	700	0.01	0.00	0.04
	800	0.02	0.01	0.06
	900	0.03	0.01	0.08
	1000	0.04	0.01	0.10
	1100	0.05	0.01	0.13
	1200	0.06	0.02	0.16
36 (3.0)	1300	0.07	0.03	0.17
	700	0.01	0.00	0.04
	800	0.02	0.01	0.06
	900	0.03	0.01	0.08
	1000	0.04	0.01	0.10
	1100	0.05	0.01	0.13
	1200	0.06	0.02	0.16
	1300	0.07	0.03	0.17
42 (3.5)	1400	0.08	0.04	0.18
	1100	0.02	0.02	0.04
	1200	0.03	0.02	0.04
	1300	0.04	0.02	0.05
	1400	0.05	0.03	0.05
	1500	0.06	0.04	0.06
	1600	0.07	0.04	0.07
	1700	0.07	0.04	0.08
	1800	0.08	0.04	0.09
	1900	0.09	0.05	0.10
48 (4.0)	2000	0.09	0.05	0.11
	1100	0.02	0.02	0.04
	1200	0.03	0.02	0.04
	1300	0.04	0.02	0.05
	1400	0.05	0.03	0.05
	1500	0.06	0.04	0.06
	1600	0.07	0.04	0.07
	1700	0.07	0.04	0.08
	1800	0.08	0.04	0.09
	1900	0.09	0.05	0.10
60 (5.0)	2000	0.09	0.05	0.11
	1100	0.02	0.02	0.04
	1200	0.03	0.02	0.04
	1300	0.04	0.02	0.05
	1400	0.05	0.03	0.05
	1500	0.06	0.04	0.06
	1600	0.07	0.04	0.07
	1700	0.07	0.04	0.08
	1800	0.08	0.04	0.09
	1900	0.09	0.05	0.10

1. The pressure drop through the economizer is greater for 100% outdoor air than for 100% return air. If the resistance of the return air duct is less than 0.25 IWG, the unit will deliver less CFM during full economizer operation. Filter pressure drop based on standard filter media tested at velocities not to exceed 300 ft/min.

SECTION VI: OPERATION

All PCE6 models contain a multi-stage compressor, therefore a multi-stage thermostat must be used.

COOLING SEQUENCE OF OPERATION

- On a call for cooling, the wall thermostat sends a 24V "Y" signal to the unit. The unit contactor closes, which energizes the outdoor fan and the compressor. The indoor blower control board sends a signal to the indoor blower motor which runs at the selected "LOW COOL" cooling speed. A 24V signal from the room thermostat to the unit "Y2" input operates the compressor at full capacity, and the indoor blower control board operates the indoor blower at the "HIGH COOL" speed. The unit does not operate on a second stage cooling call without a call on the first stage "Y1" input.
- When the demand for cooling is satisfied, the wall thermostat removes the 24V "Y" signal from the unit. The contactor opens, and the outdoor fan and compressor stop. The indoor blower control board continues to operate the indoor blower for 60 seconds after the cooling signal is removed.

Dehumidification/Humidity Switch Input

This model unit features a built in de-humidification feature for advanced dehumidification during cooling operation. The unit indoor blower control is designed to work with a humidity control that closes when the humidity is below the set-point. The control is open when the humidity is above the set-point. This humidity control may be referred to as a humidistat or dehumidistat.

To use this feature, the control "HUM STAT" jumper must be set to "YES" and a humidistat is connected from the low voltage "R" and "HUM" color coded leads. During cooling operation if the humidity level is above the humidistat set point, the indoor blower speed is reduced by approximately 15%.

Safety Controls

WARNING

The ability to properly perform maintenance on this equipment requires certain expertise, mechanical skills, tools and equipment. If you do not possess these, do not attempt to perform any maintenance other than those procedures recommended in this Installation Manual. Failure to heed this warning could result in serious injury and possible damage to this equipment.

The control circuit includes the following safety controls:

High Pressure Switch (HPS) - The switch protects against excessive discharge pressures.

Loss of Charge Switch (LCS) - The switch protects against loss of charge due to a leak in the system.

The above pressure and the loss of charge switches are specifically designed to operate with R-410A systems. R-22 pressure switches must not be used as replacements for the R-410A pressure and low charge switches.

Indoor Circulating Blower

When the thermostat calls for "FAN," the thermostat terminal "G" is energized signaling the indoor blower control board to operate the circulating blower to run continuously. The circulating blower airflow is approximately 63% of the "HIGH COOL" airflow selected on the indoor blower control board.

If a call for "COOL" occurs on "Y1," the indoor blower runs at the "LOW COOL" speed based on the "COOL" jumper setting. If a call for cool is present on "Y1"+"Y2," the indoor blower runs at the "HIGH COOL" speed based on the "COOL" jumper setting.

If a call for "HEAT" occurs "W1" or "W1"+"W2," the circulating blower runs at the heat speed based on the "HEAT" jumper setting.

When the thermostat ends the call for "FAN," the thermostat terminal "G" is de-energized, and the indoor blower control board stops the circulating blower operation.

Delay Profiles

The Delay Profiles are shown in Table 14 for each Delay jumper setting.

The levels shown in the Pre-Run, Short-Run, and Run Periods are a percentage of the blower speed corresponding to the thermostat call.

The Post-Run and Off Delay levels are derived from the level of the previous state, not the blower speed corresponding to the thermostat call.

If in Delay Profile B and in the Short-Run Period (82% of capacity) and the thermostat call is removed, this causes the control to enter the Post-Run state. The Post-Run state level for Delay Profile B is 100% of the previous level, so the level during the Post-Run state is 82%.

TABLE 14 : Delay Profile Descriptions

Delay Profile	Period	Cooling	
		Level%	Time in State (Minutes)
A	Pre-Run	Bypass	Bypass
	Short-Run	Bypass	Bypass
	Run	100	No Limit
	Post-Run*	100	1
	Off Delay*	Bypass	Bypass
B	Pre-Run	50	2
	Short-Run	82	5
	Run	100	No Limit
	Post-Run*	100	1
	Off Delay*	Bypass	Bypass
C	Pre-Run	Bypass	Bypass
	Short-Run	Bypass	Bypass
	Run	100	No Limit
	Post-Run*	100	1
	Off Delay*	50	1
D	Pre-Run	Bypass	Bypass
	Short-Run	63	1.55
	Run	100	No Limit
	Post-Run*	100	1
	Off Delay*	63	0.5

HEATING SEQUENCE OF OPERATION

(Units equipped with optional electric heat kit)

- On a call for heating, the wall thermostat sends a 24V "W" signal to "W1" on the unit. The indoor blower then runs at the selected heating speed. The 24V signal also goes to the sequencer(s) or relays in the electric heat kit and turns on the electric heating elements. All 6HK heat kits 13kW and larger require the use of a multi-stage thermostat. All 6HK heat kits 10kW and below only need an input on the "W1" connection.
- When the demand for heating is removed, the wall thermostat removes the "W" signal. When the 24V signal is removed from the electric heat kit, the heating elements turn off. The indoor blower continues to run until the electric heat blower off time delay expires. This function is built into the indoor blower control board.
- See Table 9 for blower off delay times.

Electric Heat Limit Switch Operation

The 6HK single phase heat kits utilize a normally closed line voltage limit switch and a normally closed fusible link. If the fusible link opens, it must be replaced with the appropriate OEM part and the cause must be investigated and corrected.

Table 15: Thermostat Signals

Signal	State	Board Function
G	ON	Indoor blower instant on
	OFF	Indoor blower off
W1	ON	Indoor blower instant on
		Electric heat first stage on (if so equipped)
	OFF	Electric heat first stage off (if so equipped) Indoor blower off after off delay
G & W1	ON	Indoor blower instant on in heating speed
		Electric heat first stage on (if so equipped)
	W OFF	Electric heat first stage off (if so equipped) Indoor blower switches to continuous fan speed
G & Y1	ON	Outdoor fan instant on
		Indoor blower instant on in LOW cooling speed
		Compressor on
	Y1 OFF	Compressor instant off
		Outdoor fan instant off
		Indoor blower switches to continuous fan speed after 60 seconds
	G & Y1 OFF	Compressor instant off
		Outdoor fan instant off
		Indoor blower off after 60 second delay

Table 16: Recommended Blower Speed for Electric Heat

Model	Heater kW								
	2	5	8	10	13	15	18	20	25
PCE6A24	D (LO)	D (LO)	C (ML)	B (MH)	A (HI)	--	--	--	--
PCE6A30	D (LO)	D (LO)	D (LO)	C (ML)	B (MH)	A (HI)	--	--	--
PCE6B36	D (LO)	D (LO)	D (LO)	C (ML)	B (MH)	A (HI)	--	--	--
PCE6B42	--	D (LO)	D (LO)	D (LO)	D (LO)	C (ML)	B (MH)	A (HI)	--
PCE6B48	--	D (LO)	D (LO)	D (LO)	D (LO)	C (ML)	B (MH)	A (HI)	--
PCE6B60	--	D (LO)	D (LO)	D (LO)	D (LO)	D (LO)	C (ML)	B (MH)	A (HI)

NOTE: The recommended HEAT speed selections above will give approximately a 45 degree temperature rise at 0.3" static with 230V power supply. If lower or higher heating airflow is desired, or if duct static or voltage are different than specified, other speed taps may be used.




Table 17: Enhanced ECM Indoor Blower Control Board Fault Codes

Flashes	Fault Condition
LED OFF	No power to control
LED ON	Internal control failure
SLOW RED	Control normal operation
RAPID RED	Factory Test Mode
7 RED	Call for heat and cool at the same time
8 RED	Model ID plug not inserted
9 RED	Internal fault self corrected, attempting normal operation

1. Check the electrical supply voltage being supplied. Be sure that it is within the specified range on the unit data plate.
2. Make sure all electrical connections are tight.
3. If unit is connected to 208 volt supply power, the control transformer must be wired accordingly.
4. Turn unit electrical power on.

EXTERNAL STATIC PRESSURE SETUP

To measure external static pressure:

- Measure the supply air static pressure
- Record this positive number
- Measure the return air static pressure

- Record this negative number
- Treat the negative number as a positive and add the two numbers together
- This is total system static

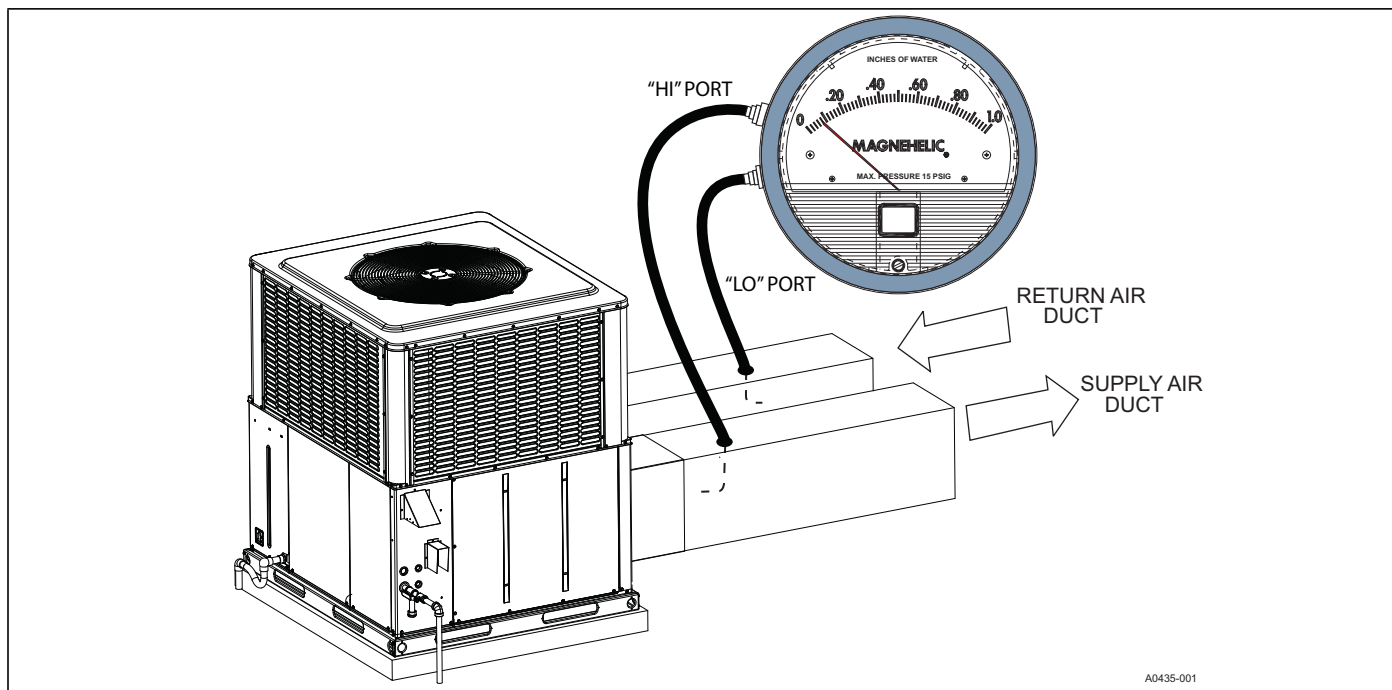


FIGURE 10: Measuring External Static Pressure

SECTION VII: MAINTENANCE

NORMAL MAINTENANCE

⚠ WARNING

Prior to any of the following maintenance procedures, shut off all power to the unit, to avoid personal injury.

Periodic maintenance consists of changing or cleaning filters and general cleaning of the outdoor coil.

FILTERS - Inspect once a month. Replace Disposable or clean Permanent Type as necessary. DO NOT replace Permanent Type with Disposable.

MOTORS - Indoor and outdoor fan motors are permanently lubricated and require no maintenance.

OUTDOOR COIL - Dirt should not be allowed to accumulate on the outdoor coil surface or other parts in the air circuit. Cleaning should be as often as necessary to keep the coil clean. If water is used to clean the coil, be sure that the power to the unit is shut off prior to cleaning.

NOTICE

DO NOT use a pressure washer as coil fin damage will occur.

⚠ CAUTION

*Exercise care when cleaning the coil so that the coil fins are not damaged.
Do not permit the hot outdoor air discharge to be obstructed by overhanging structures or shrubs.*

TROUBLESHOOTING

⚠ WARNING

Troubleshooting of components necessarily requires opening the electrical control box with the power connected to the unit. Use extreme care when working with live circuit! Check the unit nameplate for the correct range before making any connections with line terminals.

⚠ CAUTION

The wire number or color and terminal designations referred to may vary. Check the wiring label inside the control box access panel for the correct wiring.

SECTION VIII: TYPICAL WIRING DIAGRAMS

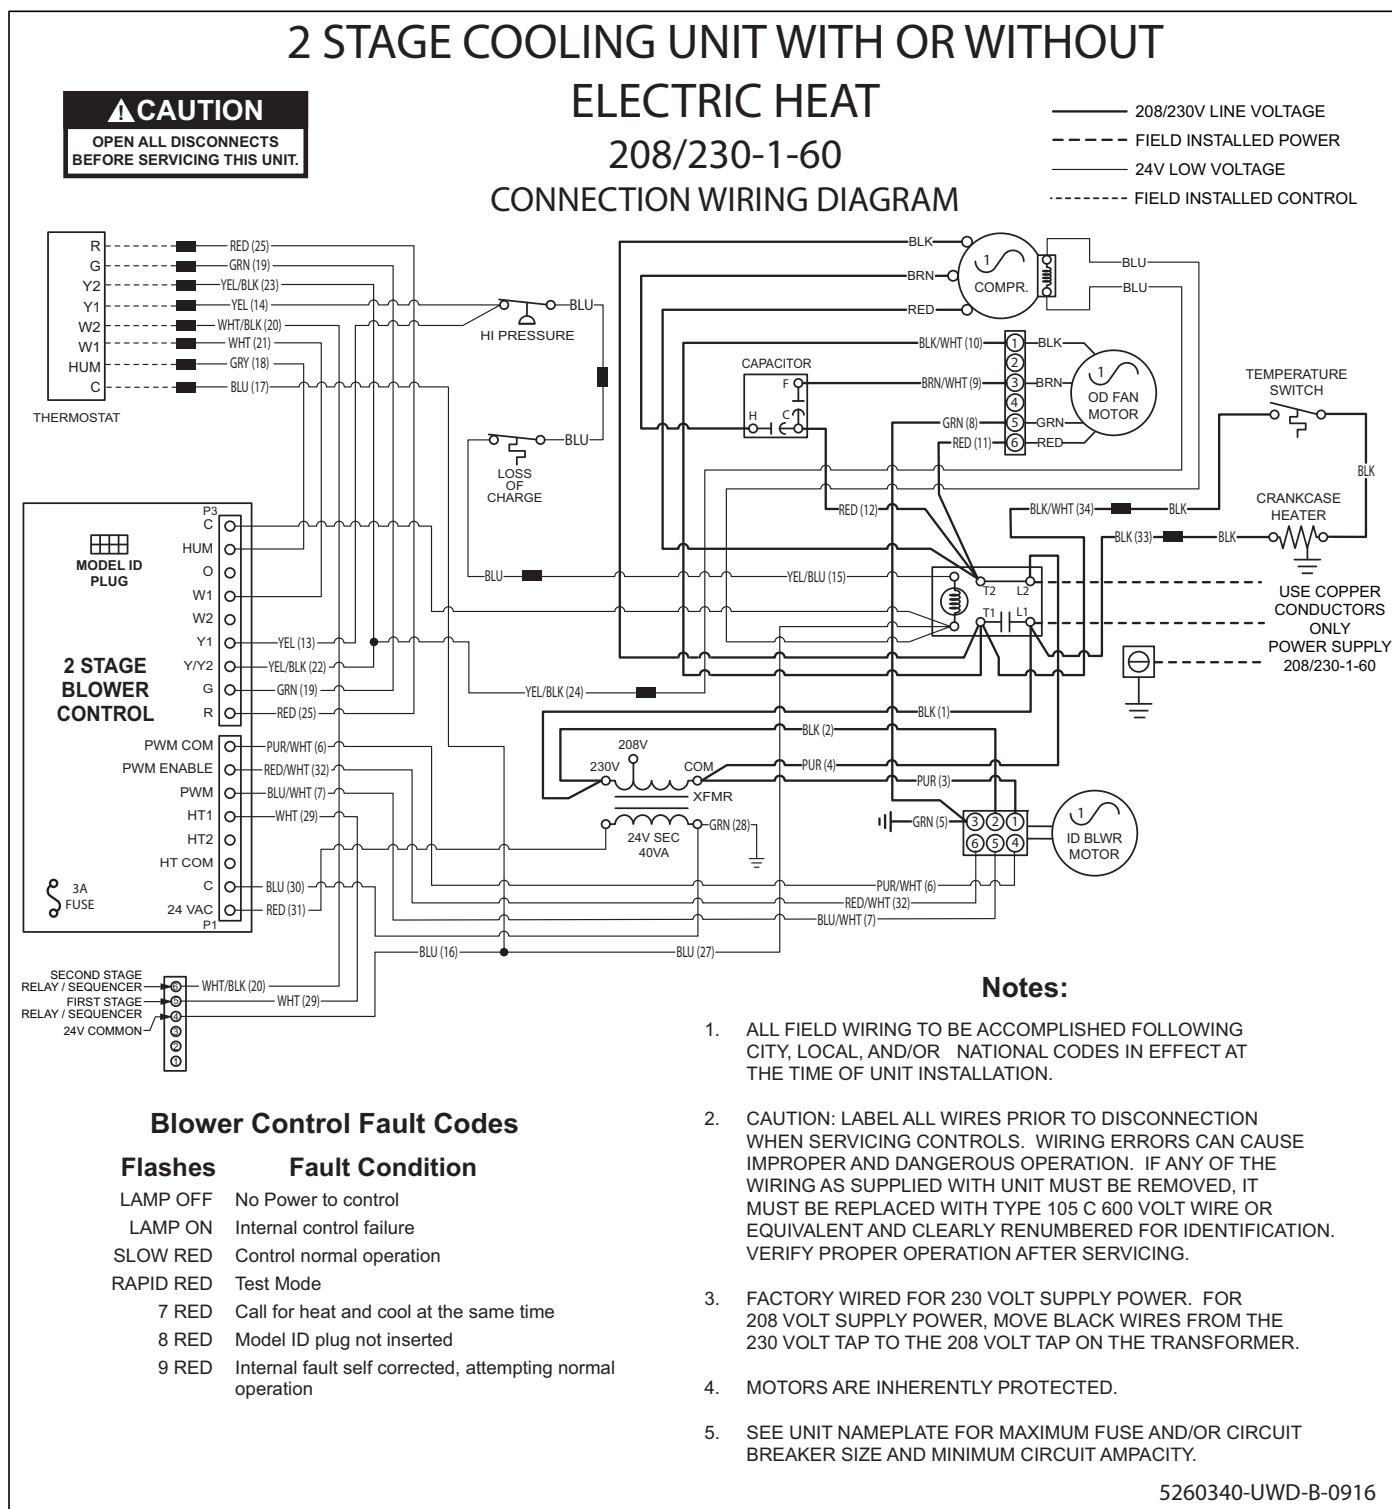


FIGURE 11: Connection Wiring Diagram

2 STAGE COOLING UNIT WITH OR WITHOUT ELECTRIC HEAT

208/230-1-60

LADDER WIRING DIAGRAM

CAUTION

OPEN ALL DISCONNECTS
BEFORE SERVICING THIS UNIT.

Notes:

1. ALL FIELD WIRING TO BE ACCOMPLISHED FOLLOWING CITY, LOCAL, AND/OR NATIONAL CODES IN EFFECT AT THE TIME OF UNIT INSTALLATION.
2. CAUTION: LABEL ALL WIRES PRIOR TO DISCONNECTION WHEN SERVICING CONTROLS. WIRING ERRORS CAN CAUSE IMPROPER AND DANGEROUS OPERATION. IF ANY OF THE WIRING AS SUPPLIED WITH UNIT MUST BE REMOVED, IT MUST BE REPLACED WITH TYPE 105 C 600 VOLT WIRE OR EQUIVALENT AND CLEARLY RENUMBERED FOR IDENTIFICATION. VERIFY PROPER OPERATION AFTER SERVICING.
3. FACTORY WIRED FOR 230 VOLT SUPPLY POWER. FOR 208 VOLT SUPPLY POWER, MOVE BLACK WIRES FROM THE 230 VOLT TAP TO THE 208 VOLT TAP ON THE TRANSFORMER.
4. MOTORS ARE INHERENTLY PROTECTED.
5. SEE UNIT NAMEPLATE FOR MAXIMUM FUSE AND/OR CIRCUIT BREAKER SIZE AND MINIMUM CIRCUIT AMPACITY.


Blower Control Fault Codes

Flashes	Fault Condition
LAMP OFF	No Power to control
LAMP ON	Internal control failure
SLOW RED	Control normal operation
RAPID RED	Test Mode
7 RED	Call for heat and cool at the same time
8 RED	Model ID plug not inserted
9 RED	Internal fault self corrected, attempting normal operation


WIRING DIAGRAM FOR
HEATER KITS:
6HK*6501306
6HK*6501506

OPTIONAL ELECTRIC HEATER ACCESSORY

SEE HEATER WIRING DIAGRAM FOR ALTERNATE
HEATER ACCESSORY KITS.

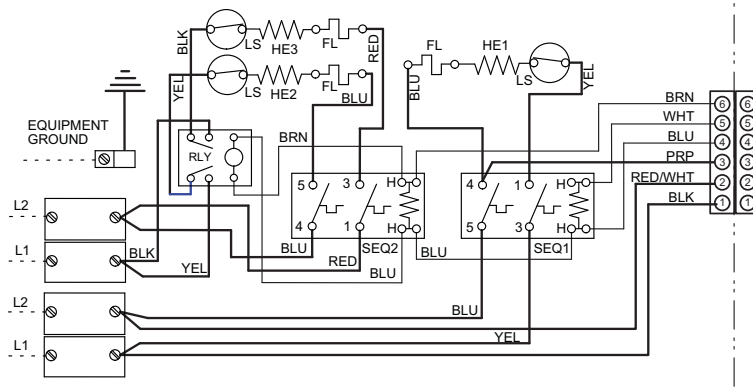

— 208/230V LINE VOLTAGE
- - - FIELD INSTALLED POWER
— 24V LOW VOLTAGE
- - - FIELD INSTALLED CONTROL

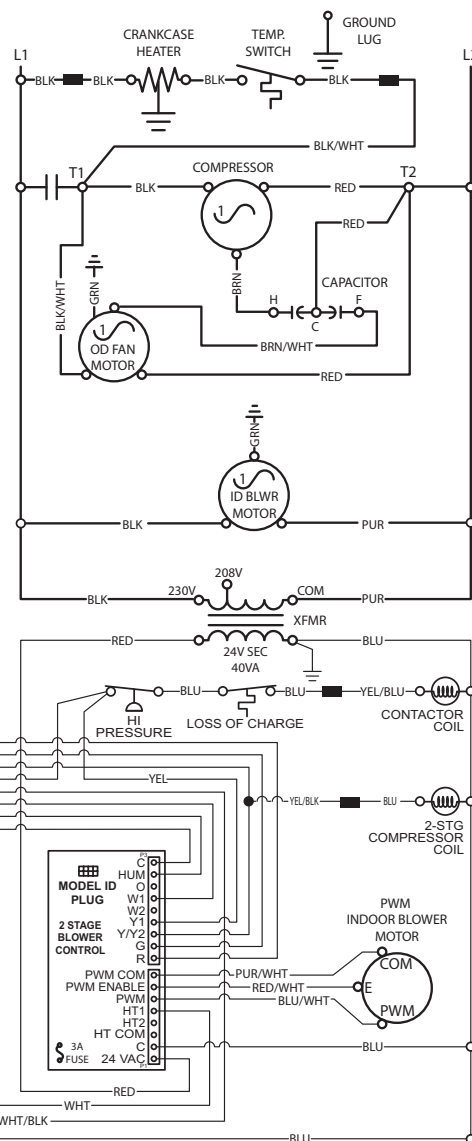

5260340-UWD-B-0916

FIGURE 12: Ladder Wiring Diagram

R-410A QUICK REFERENCE GUIDE

Refer to Installation Instructions for specific installation requirements

- R-410A refrigerant operates at 50 - 70 percent higher pressures than R-22. Be sure that servicing equipment and replacement components are designed to operate with R-410A.
- R-410A refrigerant cylinders are rose colored.
- Recovery cylinder service pressure rating must be 400 psig, DOT 4BA400, or DOT BW400.
- Recovery equipment must be rated for R-410A.
- DO NOT use R-410A service equipment on R-22 systems. All hoses, gages, recovery cylinders, charging cylinders and recovery equipment must be dedicated for use on R-410A systems only.
- Manifold sets must be at least 700 psig high side, and 180 psig low side, with 550 psig retard.
- All hoses must have a service pressure rating of 800 psig.
- Leak detectors must be designed to detect HFC refrigerants.
- Systems must be charged with liquid refrigerant. Use a commercial type metering device in the manifold hose.
- R-410A can only be used with POE type oils.
- POE type oils rapidly absorb moisture from the atmosphere.
- Vacuum pumps will **not** remove moisture from R-410A refrigerant oils.
- Do not use liquid line driers with a rated working pressure rating less than 600 psig.
- Do not install suction line driers in the liquid line.
- A liquid line drier is required on every unit.
- Do not use a R-22 TXV. If a TXV is to be used, it must be a R-410A TXV.
- Never open system to atmosphere when under a vacuum.
- If system must be opened for service, evacuate system then break the vacuum with dry nitrogen and replace all filter driers.

FIGURE 13: R-410A Quick Reference Guide

SECTION IX: START UP SHEET

Residential Package Unit Cooling With Electric Heat Start-Up Sheet

Proper start-up is critical to customer comfort and equipment longevity

Start-Up Date	<input style="width: 90%;" type="text"/>	Company Name	<input style="width: 90%;" type="text"/>	Start-Up Technician	<input style="width: 90%;" type="text"/>
---------------	--	--------------	--	---------------------	--

Owner Information

Name	<input style="width: 95%;" type="text"/>	Address	<input style="width: 95%;" type="text"/>	Daytime Phone	<input style="width: 90%;" type="text"/>
City	<input style="width: 95%;" type="text"/>	State or Province	<input style="width: 95%;" type="text"/>	Zip or Postal Code	<input style="width: 90%;" type="text"/>

Equipment Data

Unit Model #	<input style="width: 95%;" type="text"/>	Unit Serial #	<input style="width: 95%;" type="text"/>
--------------	--	---------------	--

General Information (Check all that apply)

<input type="radio"/> Residential	<input type="radio"/> New Construction	<input type="radio"/> Roof level	<input type="radio"/> Down flow
<input type="radio"/> Commercial	<input type="radio"/> Retrofit	<input type="radio"/> Grade level	<input type="radio"/> Side flow

Unit Location and Connections (Check all that apply)

<input type="checkbox"/> Unit is level and installed on:	<input type="checkbox"/> Slab	<input type="checkbox"/> Roof curb	<input type="checkbox"/> Duct connections are complete:	<input type="checkbox"/> Supply	<input type="checkbox"/> Return
<input type="checkbox"/> Condensate drain properly connected per the installation instructions			<input type="checkbox"/> Condensate trap has been primed with water		

Filters

<input type="checkbox"/> Filters installed	Number of filters	<input style="width: 90%;" type="text"/>	Filter size	<input style="width: 90%;" type="text"/>	<input type="radio"/> Filter located inside	<input type="radio"/> Filter located outside
--	-------------------	--	-------------	--	---	--

Additional Kits & Accessories Installed (Check all that apply)

<input type="checkbox"/> Refrigerant safety kit	<input type="checkbox"/> Low ambient kit	<input type="checkbox"/> Anti-recycle timer	<input type="checkbox"/> Crank case heater	<input type="checkbox"/> Filter frame kit
<input type="checkbox"/> Transformer kit	<input type="checkbox"/> Economizer	<input type="checkbox"/> Roof curb kit	<input type="checkbox"/> Burglar bar kit	<input type="checkbox"/> Hail guard kit
<input type="checkbox"/> Manual fresh air damper kit <input type="checkbox"/> Motorized fresh air damper kit				

Electrical Connections & Inspection (Check all that apply)

<input type="radio"/> Single phase	<input type="radio"/> Three phase	<input type="radio"/> 208 volts AC	<input type="radio"/> 230 volt AC	<input type="radio"/> 460 volts AC	<input type="radio"/> 575 volts AC
<input type="checkbox"/> Inspect wires and electrical connections <input type="checkbox"/> Transformer wired properly for primary supply voltage <input type="checkbox"/> Ground connected					
<input type="checkbox"/> Low voltage present at control board "R & C"			Measured voltage "R" and "C" outdoor unit control board		
<input type="checkbox"/> Line voltage present at disconnect		Measured voltage "L1 to L2"		"L2 to L3"	"L1 to L3"
Compressor amperes "L1"	<input style="width: 90%;" type="text"/>	"L2"	<input style="width: 90%;" type="text"/>	"L3"	<input style="width: 90%;" type="text"/>
Total amperes "L1"		<input style="width: 90%;" type="text"/>	"L2"	<input style="width: 90%;" type="text"/>	"L3"
<input type="radio"/> Single stage compressor <input type="radio"/> Two stage compressor					

Air Flow Setup / Cooling

Blower Type & Set-Up	<input type="radio"/> ECM	COOL	<input type="radio"/> A	<input type="radio"/> B	<input type="radio"/> C	<input type="radio"/> D
		ADJUST	<input type="radio"/> A	<input type="radio"/> B	<input type="radio"/> C	<input type="radio"/> D
		DELAY	<input type="radio"/> A	<input type="radio"/> B	<input type="radio"/> C	<input type="radio"/> D
	<input type="radio"/> X-13	<input type="radio"/> 1	<input type="radio"/> 2	<input type="radio"/> 3	<input type="radio"/> 4	<input type="radio"/> 5
	<input type="radio"/> PSC	<input type="radio"/> Low	<input type="radio"/> Medium Low	<input type="radio"/> Medium	<input type="radio"/> Medium High	<input type="radio"/> High
Supply static (inches of water column)		<input style="width: 90%;" type="text"/>	Supply air dry bulb temperature		<input style="width: 90%;" type="text"/>	Outside air dry bulb temperature
Return static (inches of water column)		<input style="width: 90%;" type="text"/>	Return air dry bulb temperature		<input style="width: 90%;" type="text"/>	Return air wet bulb temperature
Total external static pressure		<input style="width: 90%;" type="text"/>	Temperature drop		<input style="width: 90%;" type="text"/>	Supply air wet bulb temperature

<input type="radio"/> R-410A <input type="radio"/> R-22	Data plate - lbs / Oz <input type="text"/>	Suction line temperature <input type="text"/>	Discharge pressure <input type="text"/>
<input type="radio"/> TXV <input type="radio"/> Fixed Orifice		Suction pressure <input type="text"/>	Liquid line temperature <input type="text"/>
TXV# / Orifice size <input type="text"/>		Superheat <input type="text"/>	Subcooling <input type="text"/>
Discharge line temperature <input type="text"/>			

Electric heat kit - Model number				Serial number				Rated KW			
<input type="radio"/> Single Phase <input type="radio"/> Three Phase		Measured Amperage		Heater 1				Heater 2			
				Heater 3				Heater 4			
		Measured Voltage		Heater 1				Heater 2			
Number of elements						Heater 3				Heater 4	
				Heater 5				Heater 6			
Heating return air dry bulb temperature				Heating supply air dry bulb temperature				Air temperature rise			

- ☐ Job site has been cleaned, indoor and outdoor debris removed from job site
- ☐ Tools have been removed from unit
- ☐ All panels have been installed

<input type="checkbox"/>	Operate the unit through continuous fan cycles from the thermostat, noting and correcting any problems
<input type="checkbox"/>	Operate the unit through cooling cycles from the thermostat, noting and correcting any problems

- ☐ Provide owner with the owner's manual
- ☐ Explain operation of system to equipment owner
- ☐ Explain thermostat use and programming (if applicable) to owner
- ☐ Explain the importance of regular filter replacement and equipment maintenance

[illegible]